Peptide Scanner

COC# 146167
Lab # 216738
Date Rec'd 11/9/2026
Report Issued 11/18/2026

Certificate of Analysis



Project PSV-FT-P4699Z
Compound BPC-157
Label Claim 5 mg
Batch/Lot

Analyte	Result	Units	LOQ	% of Label	Method	Date	CAS
Peptides & Bioactives							
Chromatographic purity	>99.9	%	1		HPLC-UV/MS	11/13/2026	
BPC-157	3.52	mg	.1	70.4	HPLC-UV-MS	11/13/2026	137525-51-0
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	11/13/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Data is not for regulatory compliance nor diagnostic use.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
OCH - above calibrated range OCL - below calibrated range
All values reported on a per vial basis unless otherwise noted
Copyright © 2026 Krause Analytical LLC. All rights reserved.

Respectfully submitted,

Mark C. Krause
Laboratory Director

HPLC Chromatogram of 216738 , 220 nm

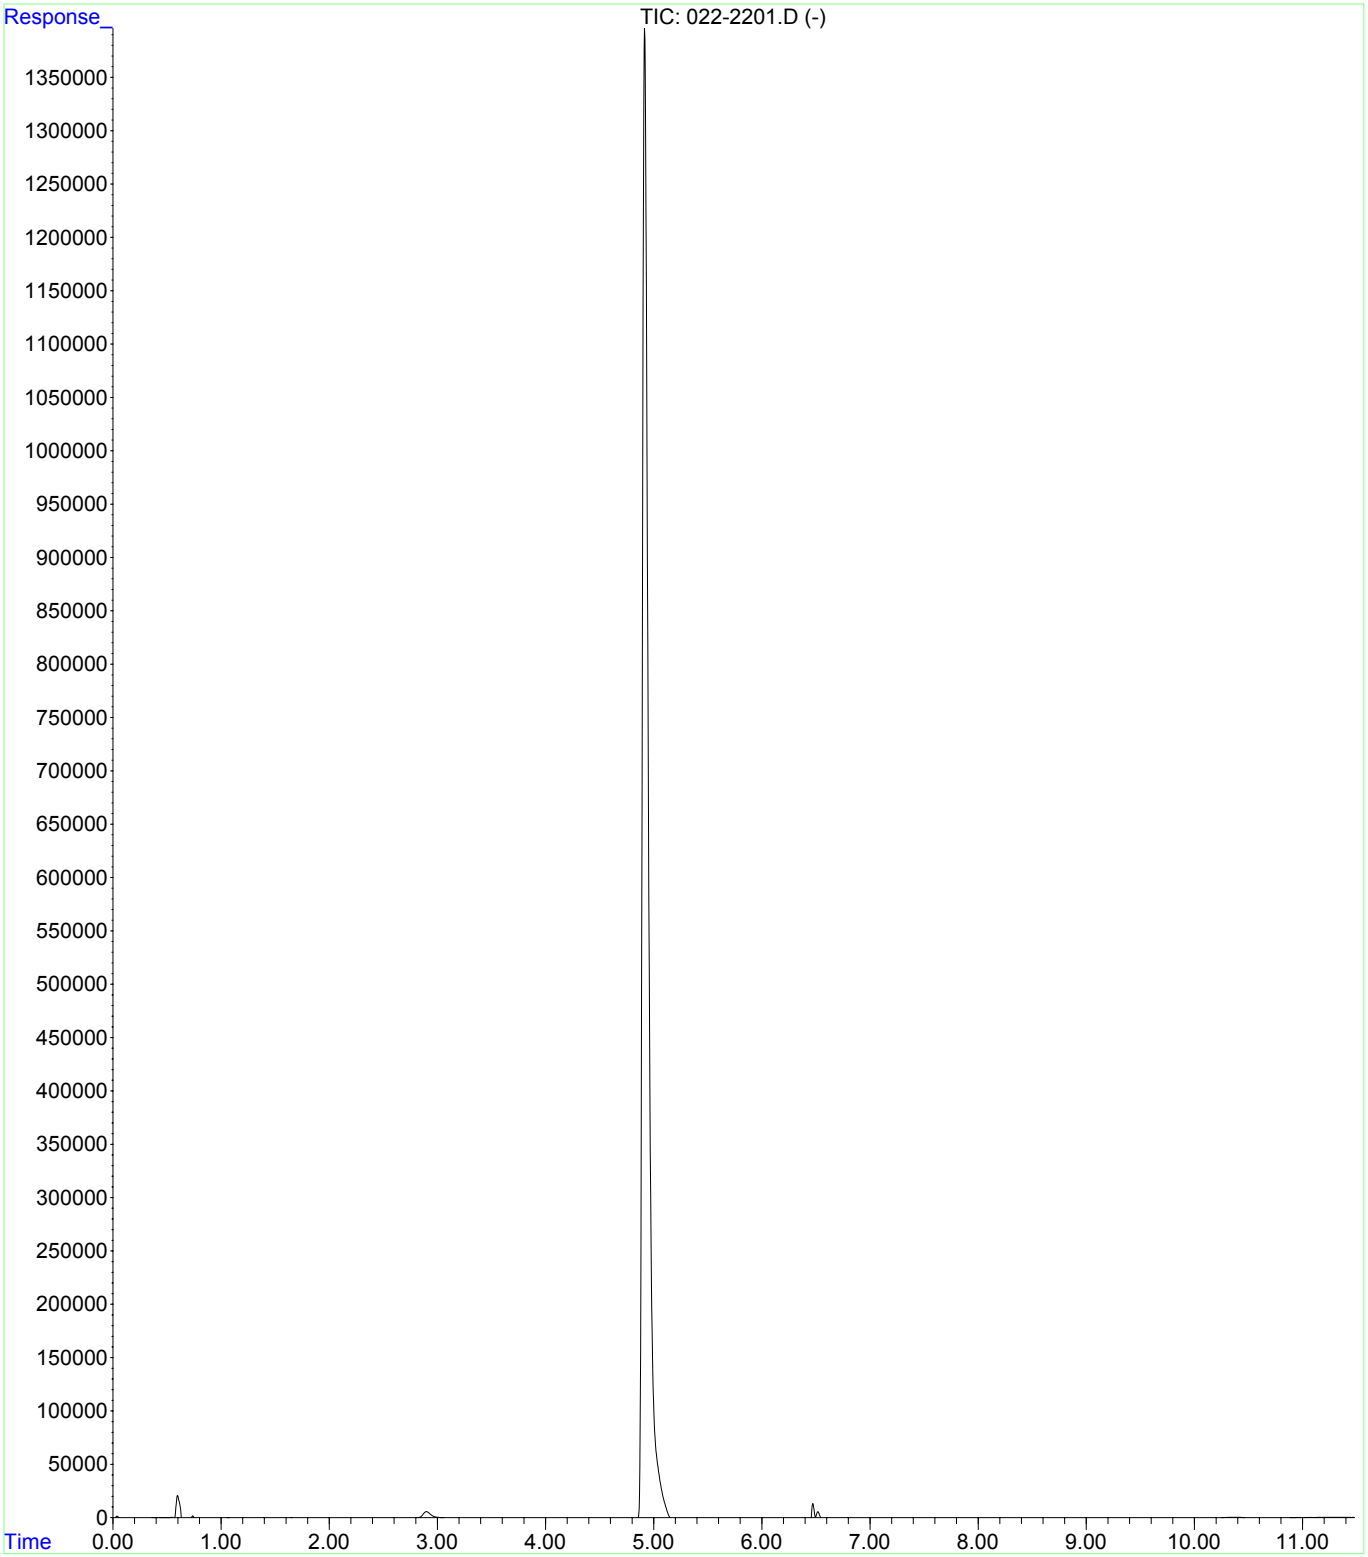

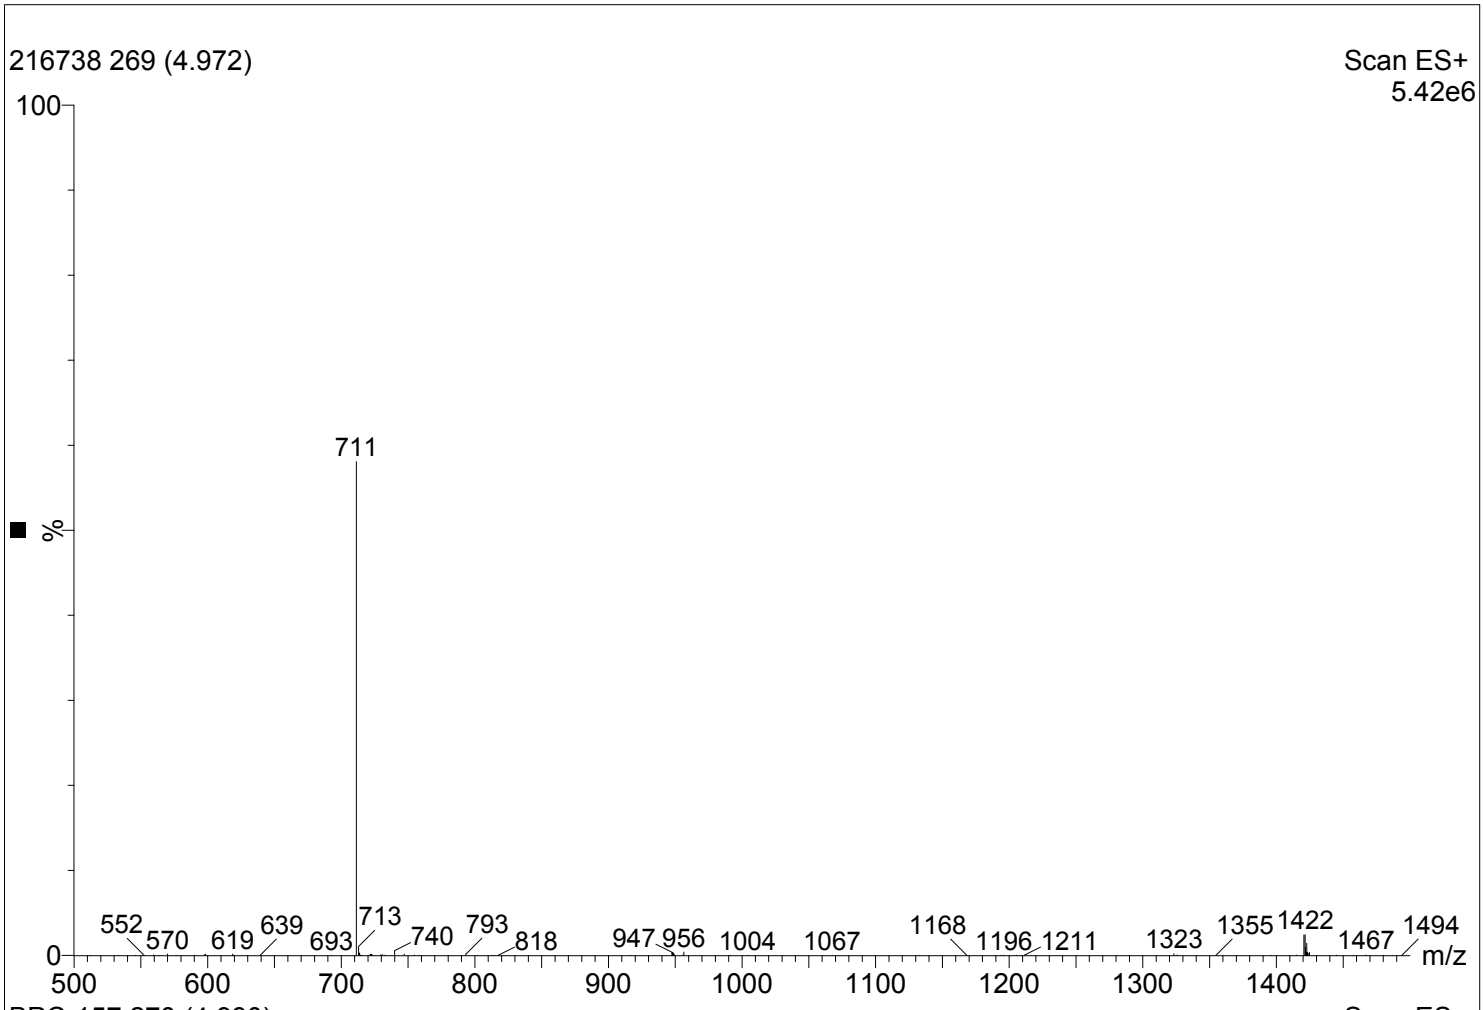
216738 269 (4.972)
Scan ES+
5.42e6
100
%
0
711
552
570
619
639
693
713
740
793
818
947
956
1004
1067
1168
1196
1211
1323
1355
1422
1467
1494
m/z
500
600
700
800
900
1000
1100
1200
1300
1400

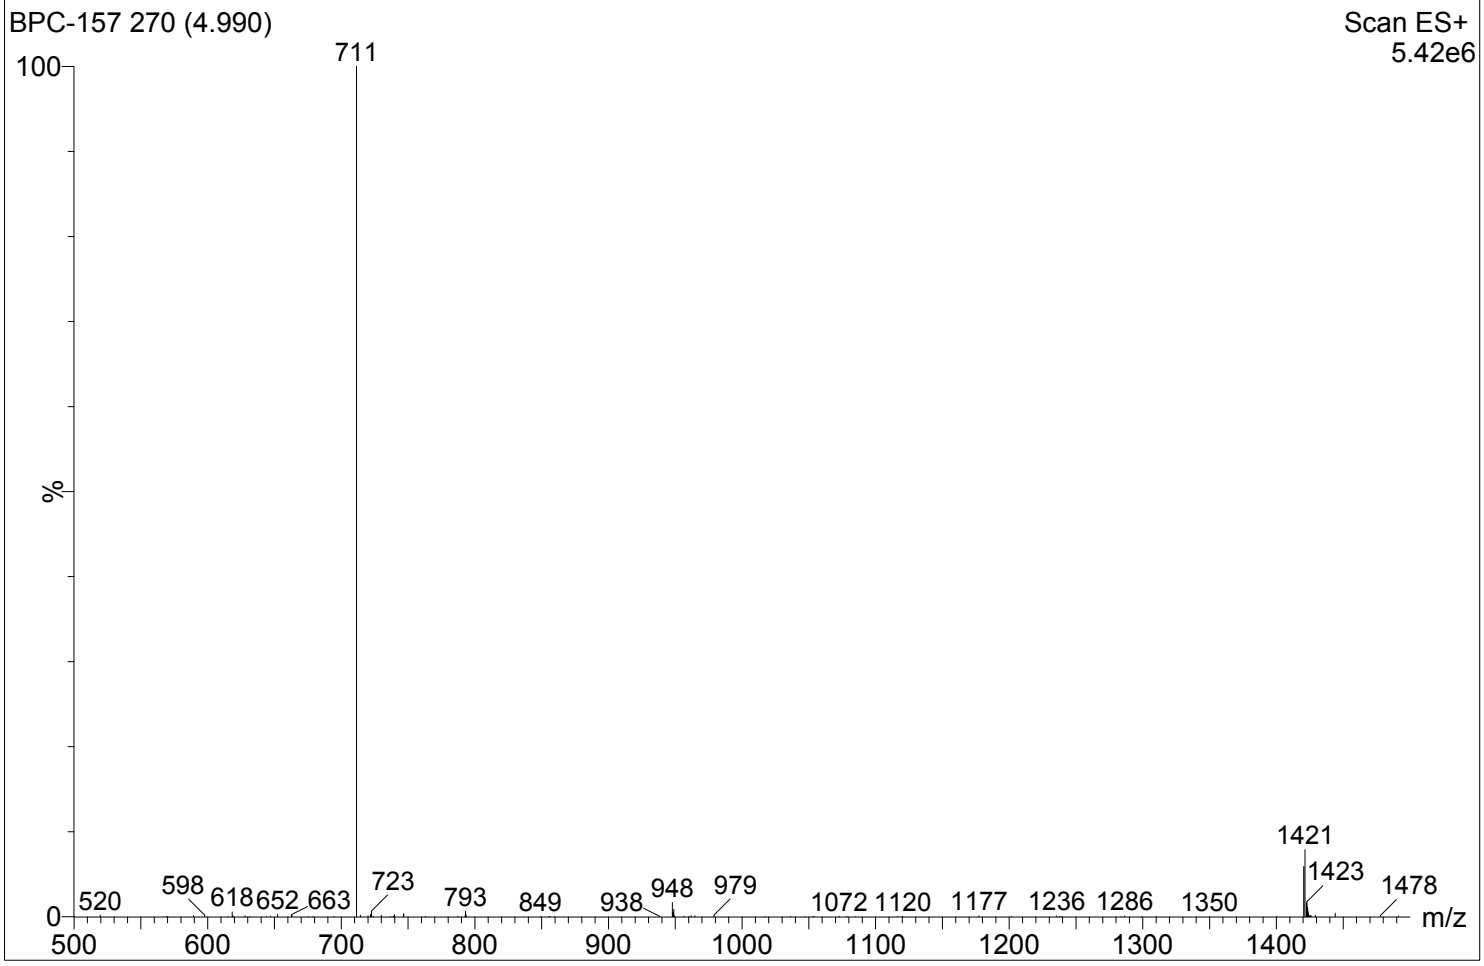
BPC-157 270 (4.990)
Scan ES+
5.42e6
100
%
0
711
520
598
618
652
663
723
793
849
938
948
979
1072
1120
1177
1236
1286
1350
1421
1423
1478
m/z
500
600
700
800
900
1000
1100
1200
1300
1400